



National City Fire Department Community Risk Reduction Division

Business Self-Inspection Form

This self-inspection checklist is provided to help business owners and managers identify and correct common fire and life safety issues before an official fire inspection.

Business Name: _____

Address: _____

Email: _____

Phone: _____

Please walk through your business, check each item, and fix anything not in compliance. Return the signed form to the National City Fire Department (1243 National City Blvd., National City, CA 91950) or email it to fire@nationalcityca.gov.

General Building Safety

- 1. Building address numbers are posted, clearly visible from the street, and at least 4" high
- 2. All exit doors are easily openable from the inside without a key, tool, or special knowledge.
- 3. Exit signs are illuminated in green color and in good working order per *National City Municipal Code*.

Fire Extinguishers

- 1. Fire extinguishers are mounted, visible, and accessible (not blocked).
- 2. Each extinguisher has been inspected and tagged within the past 12 months by a licensed company.

Electrical Safety

- 1. Electrical panels have 30" of clearance and are not blocked.
- 2. No extension cords are used as permanent wiring.
- 3. Power strips are UL-listed and plugged directly into wall outlets (not daisy-chained).

Housekeeping & Storage

- 1. Combustible materials (paper, boxes, etc.) are stored away from heat sources.
- 2. Flammable liquids are stored in approved containers/cabinets.
- 3. Storage does not block exits, fire extinguishers, sprinklers, or electrical panels.

Date of Self-Inspection: _____

Certification:

I, _____ (owner/manager), certify under penalty of perjury that the information provided is accurate and that all noted violates will be corrected promptly.

Signature: _____ Date: _____



General Building Safety:


1.



2.



3.

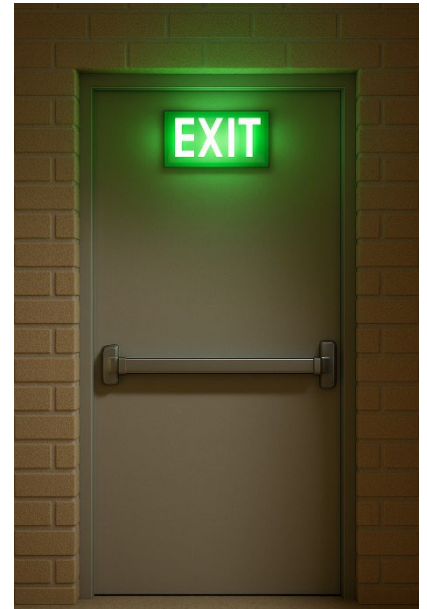

Fire Extinguishers:

1.- 2.




Electrical Safety:


1.



Electrical Safety:

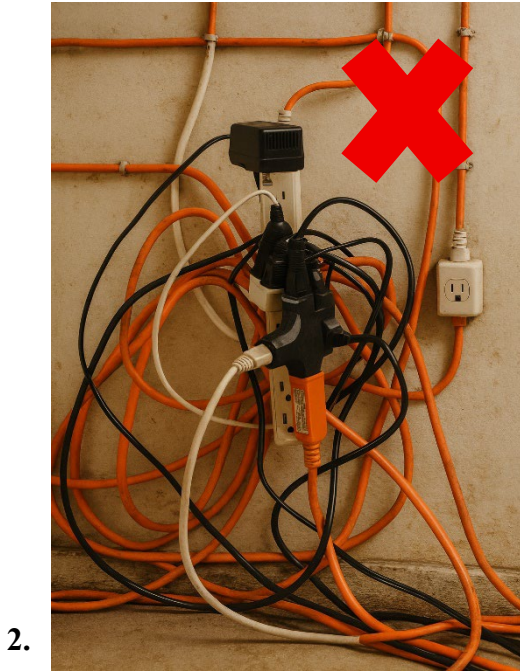

House Keeping Storage:

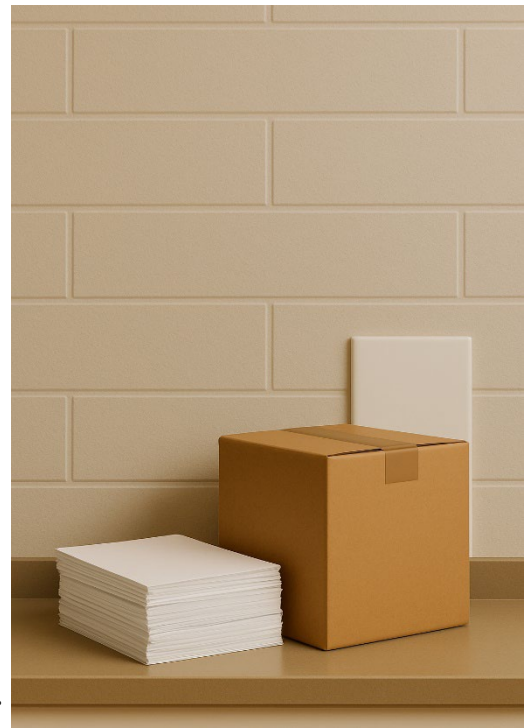

House Keeping Storage:

